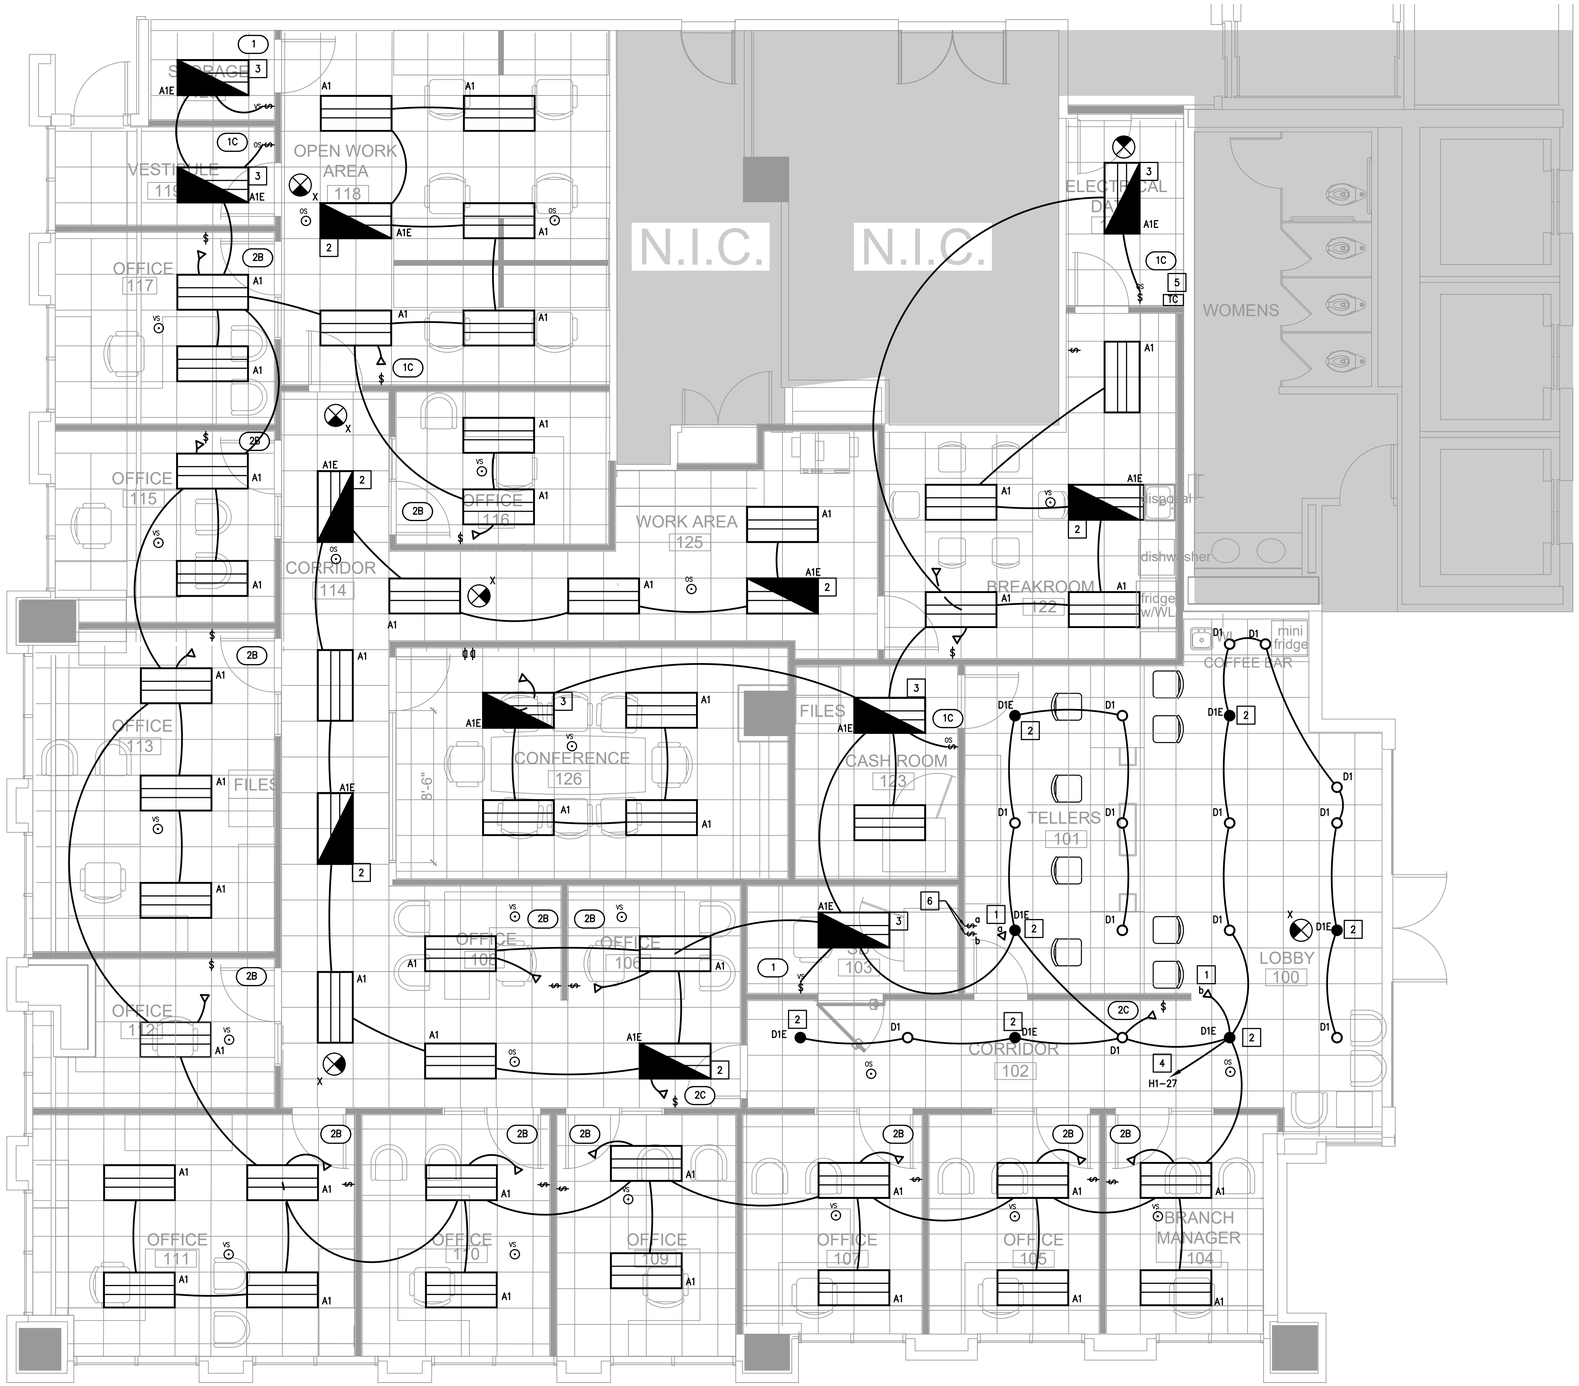

01 ELECTRICAL LIGHTING PLAN

SCALE: 1/4"=1'-0"

ELECTRICAL LIGHTING KEYED NOTES:

1. THESE LIGHT FIXTURES SHALL BE CONTROLLED BY THE TIMECLOCK. REFER TO LIGHTING CONTROL NOTES FOR MORE INFORMATION.
2. CROSS HATCHING INDICATES EMERGENCY LIGHTING. CONNECT TO FLOOR EMERGENCY LIGHTING CIRCUIT. VERIFY LOAD DOES NOT EXCEED 4400V.A. PER 20A., 277V. CIRCUIT. FIXTURE TO RUN CONTINUOUSLY AND UN-SWITCHED.
3. CROSS HATCHING INDICATES EMERGENCY LIGHTING. CONNECT TO FLOOR EMERGENCY LIGHTING CIRCUIT. VERIFY LOAD DOES NOT EXCEED 4400VA. PER 20A., 277V. CIRCUIT. PROVIDE RELAY SO THAT FIXTURE IS SWITCHED UNDER NORMAL OPERATIONS.
4. REUSE EXISTING LIGHT CIRCUIT(S) IN THIS AREA. CONTRACTOR TO CIRCUIT TRACE TO IDENTIFY EXACT CIRCUIT USED.
5. TIMECLOCK LOCATION. REFER TO LIGHTING CONTROL NOTES FOR ADDITIONAL INFORMATION.
6. 2-HOUR OVERRIDE SWITCH. REFER TO LIGHTING CONTROL NOTES FOR ADDITIONAL INFORMATION.

SLI DESIGN, INC.

ARCHITECTURE PLANNING INTERIOR DESIGN

15810 PARK TEN PLACE, SUITE 300
HOUSTON, TEXAS 77084
713-465-4650
www.sligroup.com

© COPYRIGHT

ALBA BANK
11700 Katy Freeway
Suite 175
Houston TX 77079

E/B/E PROJECT NUMBER: 26098.00

ISSUED FOR CLIENT APPROVAL	DATE 06/24/2026
ISSUED FOR BIDDING	06/24/2026
ISSUED FOR PERMIT	06/24/2026
ISSUED FOR CONSTRUCTION	

REVISIONS

MARK	DESCRIPTION	DATE
	PERMIT AND CONSTRUCTION SET	06/24/2026

The information, ideas, designs, details, layouts, techniques, features, arrangements, plans, sequences, dimensions, allowances, tolerances, conceptions, specifications, intentions, technology or embodiments, as illustrated, arranged, displayed, noted, recorded, indicated, represented, disclosed, evidenced, detailed or otherwise reduced to tangible form hereon, either expressly, inherently or by implication, are the confidential and proprietary information of SLI Design, Inc., and shall not be used for any purpose other than the specific project or undertaking identified on the drawing title block or legend for which they are and have been prepared by SLI Design, Inc. Any other reproduction, disclosure or use of any portion of the confidential and proprietary information of SLI Design, Inc., shall be a breach of the obligation of confidence created by the acceptance of this drawing from SLI Design, Inc. for a specific project or Contract. Any copying, duplicating, reproducing, utilization, alteration, modification, revision or change to this drawing, is expressly prohibited unless done with the prior written consent or approval of SLI Design, Inc., and shall not be undertaken without receipt of such prior written approval. This drawing is loaned by SLI Design, Inc., for the limited purpose of complying with a specific Contract. The drawing remains the property of SLI Design, Inc., and shall be returned upon request or completion of the contract, unless specifically authorized by Contract, under which it was loaned.

DESIGN TEAM
PM: JG
MECHANICAL: CC
PLUMBING: CC
ELECTRICAL: JG
CHECKED-BY: JG

STATE OF TEXAS
JOSE M. GUERRERO
154536
LICENSED PROFESSIONAL ENGINEER
06/24/2026

E|B|E CONSULTING ENGINEERS Mechanical Electrical Plumbing
12603 Southwest Frwy, Ste 170, Stafford, Tx 77477
Tel: (713) 840-0177 / Firm Reg. No: 5638

DRAWING TITLE
ELECTRICAL LIGHTING PLAN

SHEET NO.
E1.01