

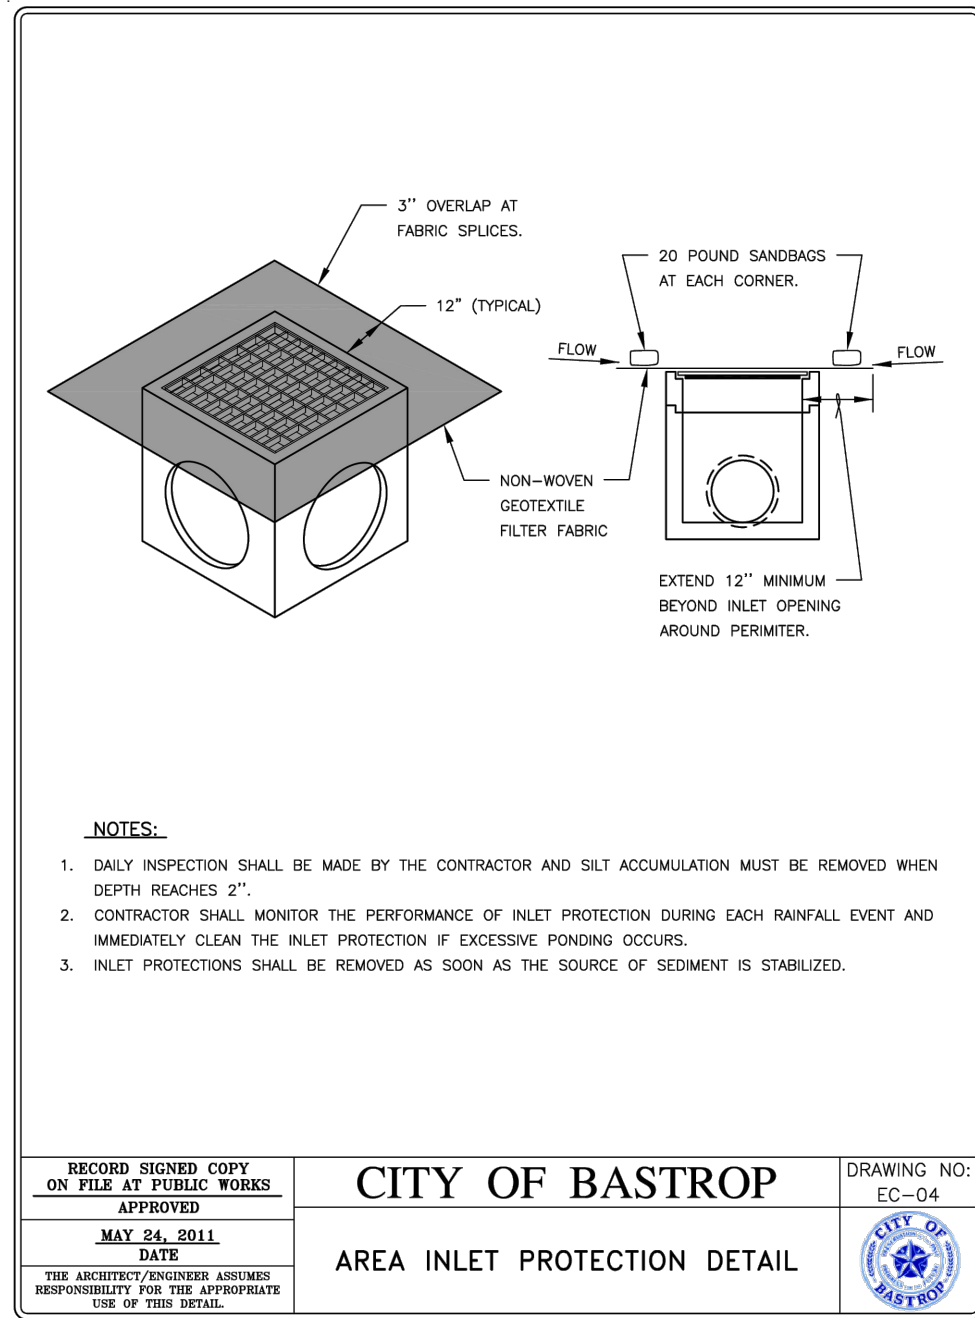


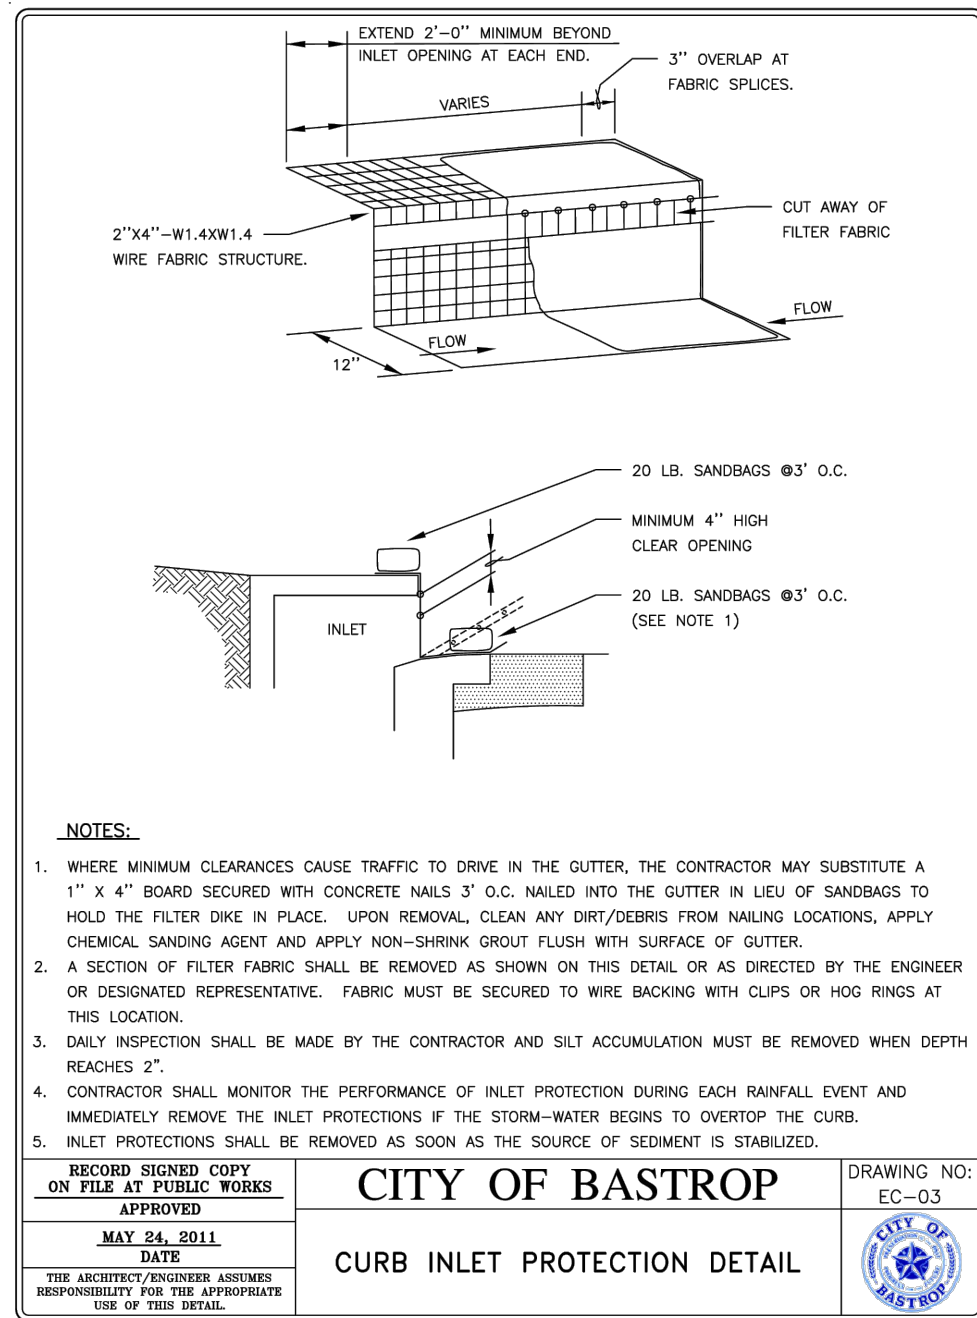

1. WASHOUT SHALL BE INSTALLED PRIOR TO PLACING ANY CONCRETE ON-SITE.
2. INSTALL DIRECTIONAL SIGNS AS NECESSARY TO INDICATE WASHOUT LOCATION TO CONCRETE SUPPLY VEHICLES.
3. WASHOUT SHALL BE INSPECTED WEEKLY AND AFTER RAIN EVENTS IN ACCORDANCE WITH SWPPP.
4. CONTRACTOR TO MAINTAIN, REPAIR, ENLARGE OR RELOCATE WASHOUT AS NECESSARY TO MEET PROJECT REQUIREMENTS.
5. WHEN NECESSARY DURING CONSTRUCTION, OR AT THE COMPLETION OF ALL CONSTRUCTION, CONCRETE SHALL BE REMOVED AND LAWFULLY DISPOSED OF AND THE WASHOUT AREA FILLED WITH COMPACTED SELECT FILL.
6. CONCRETE WASHOUT SHALL NOT BE LOCATED WITHIN 50' OF STORM INLET, DITCH, OR SUBSURFACE DRAINAGE SYSTEM.

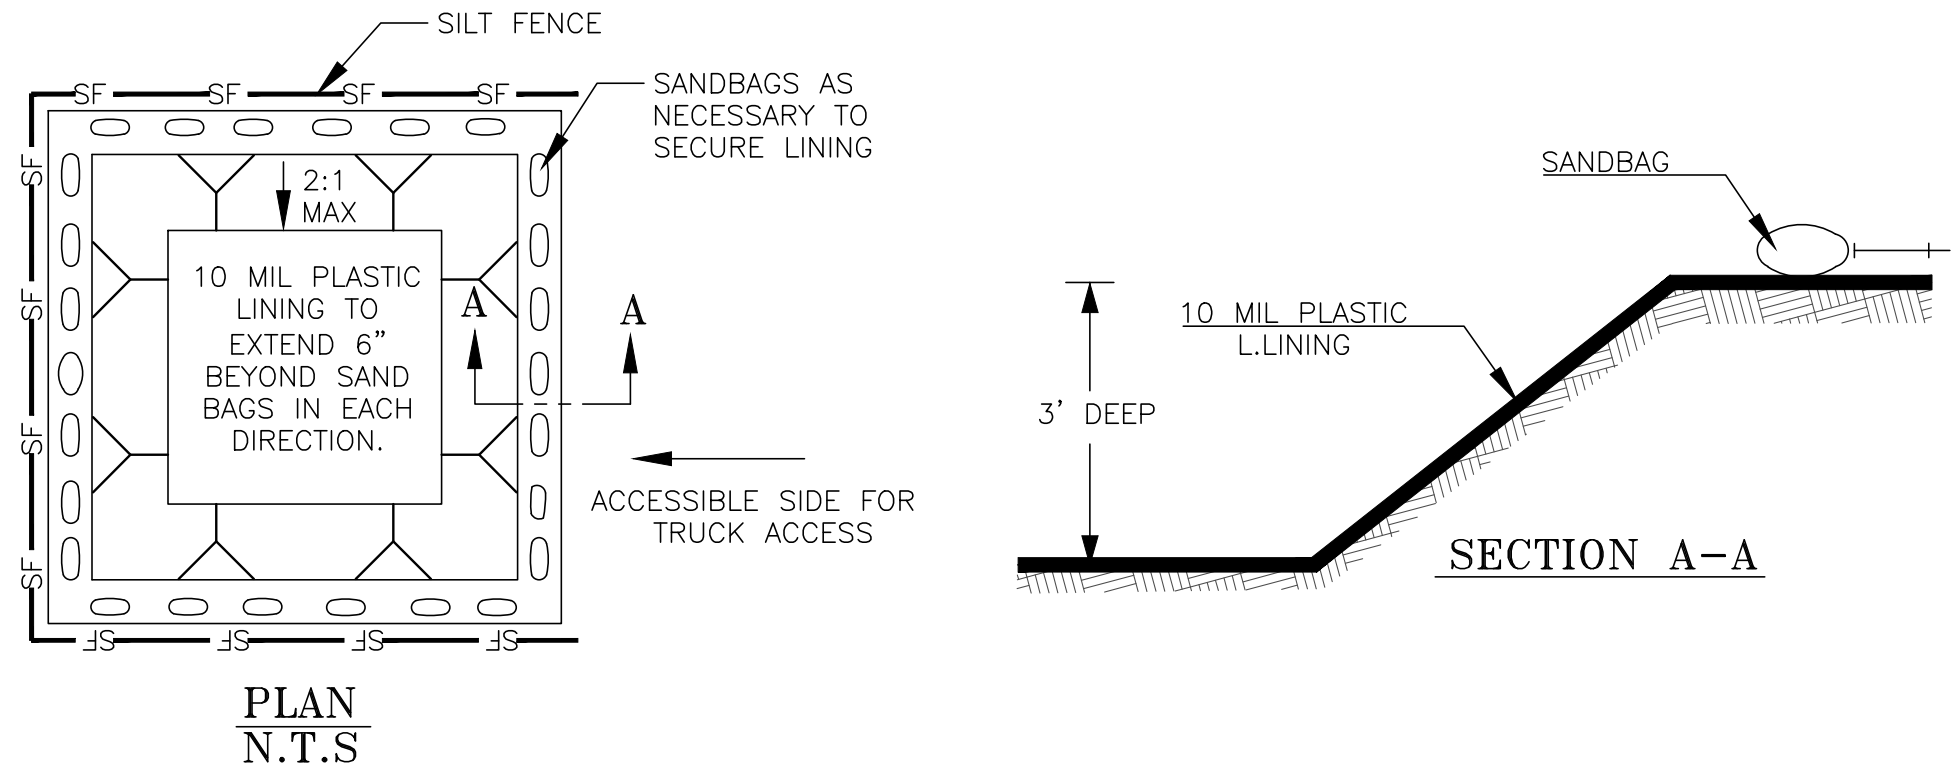

CONCRETE WASHOUT DETAIL
N.T.S

D. RESTORATION SHALL BE ACCEPTABLE WHEN THE GRASS HAS GROWN AT LEAST 1 INCH HIGH WITH % COVERAGE, PROVIDED NO BARE SPOTS LARGER THAN 20 SQUARE FEET EXIST.

(B) TCEQ AND EPA PERMITTING SHALL ALSO BE THE RESPONSIBILITY OF THE RESPONSIBLE PARTY AND THEIR ENGINEER.