

CONCRETE

1. ALL CONCRETE REINFORCING BARS SHALL CONFORM TO ASTM A615, GRADE 60, EXCEPT WHERE NOTED. NO. 10 THROUGH NO. 18 BARS SHALL CONFORM TO ASTM A615, GRADE 75. DEFORMED BAR ANCHORS SHALL CONFORM TO ASTM A496, GR 70. ALL BARS SHALL BE NEW OR RECYCLED DOMESTIC BILLET STEEL OF A DOMESTIC MANUFACTURER.
2. CONCRETE IN THE FOLLOWING AREAS SHALL HAVE SAND AND CRUSHED CARBONATE AGGREGATE CONFORMING TO ASTM C33 FOR NORMAL WEIGHT CONCRETE AND LIGHT WEIGHT AGGREGATES CONFORMING TO ASTM C330, TYPE I PORTLAND CEMENT CONFORMING TO ASTM C150, AND THE FOLLOWING DESIGNATED COMPRESSIVE STRENGTH (f'c) IN 28 DAYS:

CONCRETE USE OR CLASS	MINIMUM 28 DAY COMPRESSIVE STRENGTH (f'c)	MAXIMUM WATER CEMENT RATIO	SLUMP (INCHES)
FOOTINGS	3000 PSI	0.50	5 TO 8
SLABS ON GROUND SEE NOTE 4	4000 PSI	0.45	4 TO 6
ALL OTHER CONCRETE	3000 PSI	0.50	4 TO 6

SLUMP SHALL BE MEASURED FROM SAMPLES TAKEN AT THE POINT OF DISCHARGE UNLESS AGREED TO IN WRITING PRIOR TO CONCRETE PLACEMENT

- NOTE: CONCRETE SUPPLIER SHALL BE AWARE OF CEMENTS THAT CAN CAUSE LATE ETTRINGITE FORMATION IN THE CEMENT PASTE AND BE PREPARED TO SHOW THAT THE CEMENTS USED WILL NOT CAUSE THIS PROBLEM.
3. FLY ASH MAY BE USED AS A POZZOLAN TO REPLACE A PORTION OF THE PORTLAND CEMENT IN A CONCRETE MIXTURE, SUBJECT TO THE APPROVAL OF THE ARCHITECT AND SER. FLY ASH, WHEN USED, SHALL CONFORM TO ASTM C618 TYPE "C". CONCRETE MIXTURES CONTAINING FLY ASH SHALL BE PROPORTIONED TO ACCOUNT FOR THE PROPERTIES OF THE SPECIFIC FLY ASH AND TO ACCOUNT FOR THE SPECIFIC PROPERTIES OF THE FLY ASH CONCRETE THUS RESULTING, INCLUDING BUT NOT LIMITED TO WATER CEMENT RATION AND MINIMUM 28 DAY COMPRESSIVE STRENGTH. THE RATIO OF THE AMOUNT BY VOLUME OF FLY ASH TO THE TOTAL AMOUNT BY VOLUME OF CEMENTITIOUS MATERIAL (INCLUDING THE FLY ASH) SHALL NOT EXCEED 25 PERCENT.
4. FLY ASH IS NOT PERMITTED IN SLABS WITHOUT PRIOR WRITTEN APPROVAL FROM THE ARCHITECT AND SER.
5. AIR ENTRAINMENT IS REQUIRED ONLY IN HARD ROCK CONCRETE PERMANENTLY EXPOSED TO WEATHER CONDITIONS. WHERE LIGHTWEIGHT CONCRETE IS SPECIFIED, AIR ENTRAINMENT IS REQUIRED FOR ALL EXPOSURE CONDITIONS. PERCENT AIR ENTRAINMENT LISTED IS PLUS/MINUS 1.5%. DO NOT AIR-ENTRAIN INTERIOR FLOOR SLABS THAT RECEIVE HARD TROWEL FINISH.
6. CONCRETE PROTECTION FOR REINFORCEMENT SHALL BE AS FOLLOWS; SEE SEC. 7.7 ACI 318, LATEST EDITION FOR CONDITIONS NOT NOTED. PROVIDE CHAIR SUPPORTS (AZTEC CASTLE CHAIR, OCM CRABLE CHAIRS, WHO SERIES "E" OR EQUAL) TO ADEQUATELY SUPPORT BARS FOR PROPER CLEARANCE AS RECOMMENDED BY THE AMERICAN CONCRETE INSTITUTE AND THE CONCRETE REINFORCING STEEL INSTITUTE. SLAB ON GRADE REINFORCEMENT SHALL BE SUPPORTED AT 45-INCH MAXIMUM INTERVALS 5 OR EVERY THIRD BAR. UTILITY OR CONCRETE BRICKS ARE NOT ALLOWED AS REINFORCING SUPPORTS.

MINIMUM CONCRETE COVER REQUIREMENTS	
LOCATION	MINIMUM COVER
FOOTINGS	3 INCHES
	3 INCHES BOTTOM
GRADE BEAMS	2 INCHES SIDES — FORMED SURFACE
	3 INCHES SIDES — EARTH FORMED
	1 — 1/2 INCHES TOP
SLAB ON GROUND	1 INCH TOP

7. NO HORIZONTAL JOINTS WILL BE PERMITTED IN CONCRETE EXCEPT WHERE THEY NORMALLY OCCUR OR WHERE NOTED. NO JOINTS BETWEEN PILASTERS AND GRADE BEAM THAT ARE MEANT TO BE MONOLITHIC. VERTICAL JOINTS SHALL OCCUR AT CENTER SPANS OR AT LOCATIONS APPROVED BY THE STRUCTURAL ENGINEER.
8. CONSTRUCTION JOINTS BETWEEN PIERS AND PIER CAPS OR GRADE BEAMS, FOOTINGS AND WALLS OR COLUMNS, OR WALLS, COLUMNS, BEAMS AND THE FLOOR SYSTEM THEY SHALL SUPPORT SHALL BE PREPARED BY ROUGHENING THE SURFACE CONTACT SURFACE TO A FULL AMPLITUDE ON 1/4" LEAVING THE CONTACT SURFACE CLEAN AND FREE OF ALL LAITANCE.
9. DETAILING OF CONCRETE REINFORCEMENT AND ACCESSORIES SHALL BE IN ACCORDANCE WITH ACI PUBLICATION 315, LATEST EDITION "DETAILS AND DETAILING OF CONCRETE REINFORCEMENT" AND ACI SP -66 "DETAILING MANUAL". PLACING OF REINFORCING BARS SHALL CONFORM TO THE RECOMMENDATIONS OF ACI 318R "MANUAL OF ENGINEERING AND PLACING DRAWINGS FOR REINFORCED CONCRETE STRUCTURES" AND CRSI "MANUAL OF STANDARD PRACTICE". ALL HOOKED BARS SHOWN IN THE DETAILS SHALL HAVE STANDARD HOOKS UNLESS NOTED OTHERWISE.
10. REINFORCING BARS SHALL NOT BE WELDED WITHOUT APPROVAL OF THE STRUCTURAL ENGINEER. REINFORCING STEEL THAT REQUIRES WELDING SHALL CONFORM TO ASTM A706, WITH GRADES AS SHOWN ABOVE.
11. UNLESS BARS ARE SPECIFICALLY SHOWN IN THE BAR BENDING DIAGRAMS ON THE SCHEDULES, PROVIDE BARS AS FOLLOWS:
- A) PROVIDE STANDARD 90 DEGREE HOOK ON TOP BARS AT CANTILEVER ENDS.
- B) SPLICE BOTTOM BARS DIRECTLY OVER MEMBER SUPPORTS, UNLESS NOTED OTHERWISE.
- C) SPLICE TOP AND INTERMEDIATE BARS AT THE CENTER LINE BETWEEN MEMBER SUPPORTS, UNLESS NOTED OTHERWISE.
- D) SPLICE VERTICAL BARS IN WALLS ONLY AT FLOOR LINES, UNLESS NOTED OTHERWISE. HORIZONTAL BARS SHALL BE SPLICED AS SPECIFIED FOR TOP, BOTTOM, AND INTERMEDIATE BARS OF BEAMS.
- E) CENTER BARS NOTED AS "AT SUPT'S." OVER MEMBER SUPPORTS, AND CENTER BARS NOTES AS "BTWN. SUPT'S." BETWEEN SUPPORTS.
- F) PLACE BARS NOTED AS "2ND LAYER" BELOW THE PRIMARY TOP BARS (OR ABOVE THE PRIMARY BOTTOM BARS) AND PROVIDE #11 SPACER BARS PLACED AT INTERVALS OF 4'-0" BETWEEN THE TWO LAYERS OF BARS.
- G) SPLICE VERTICAL BARS IN COLUMNS ONLY AT FLOOR LINES, UNLESS NOTED OTHERWISE. COLUMN BAR SPLICES SHALL BE AS SHOWN IN THE COLUMN SCHEDULE.
- H) PROVIDE CORNER BARS FOR EACH HORIZONTAL BAR AT THE INSIDE AND OUTSIDE FACES OF INTERSECTING BEAMS OR WALLS. REFER TO CORNER BAR DETAILS IN THE TYPICAL DETAILS.
- I) REFER TO THE COLUMN REINFORCING DIAGRAMS FOR ADDITIONAL TIES ABOVE AND BELOW THE FLOOR FRAMING MEMBERS.
12. BARS SHOWN IN THE SCHEDULE TO HOOK AT DISCONTINUOUS ENDS SHALL HAVE THE HOOK PLACED HORIZONTALLY AT EXTERIOR CORNERS.
13. PROVIDE NO. 3 DOWELS X 2'-0" AT 1'-6" ON CENTER, WITH A 90 DEGREE HOOK AT ALL EDGES OF CONCRETE SLABS, UNLESS DETAILED OTHERWISE.
14. PROVIDE FOUNDATION DOWELS TO MATCH MASONRY WALL REINFORCEMENT. DOWELS SHALL EXTEND INTO THE CONCRETE AND CMU PER THE LAP SCHEDULES.
15. ALL CONTINUOUS REINFORCEMENT SHALL LAP 40 BAR DIAMETERS AT SPLICES. PROVIDE (I) NO. 6 X 6'-0" TOP AND BOTTOM (TWO 36" LEGS WITH 90 DEGREE BEND) AT EACH FACE OF GRADE BEAMS AT CORNERS AND INTERSECTIONS, AND AT 18" ON CENTER VERTICALLY AT WALLS.
16. PROVIDE (I) NO. 4 BAR X 4'-0" FOR ELEVATED SLABS AND (2) NO. 5 BARS X 4'-0" FOR SLAB ON GROUND AT ALL RE-ENTRANT CORNERS. PROVIDE (I) NO. 4 BAR X 4'-0" AROUND ALL RECTANGULAR OPENINGS OR COLUMN BLOCK OUTS UNLESS NOTED OTHERWISE. FOR ELEVATED SLABS, PLACE THE DIAGONAL BARS WITH 1 INCH OF CLEARANCE FROM TOP AND THE SIDES OF THE SLAB AT THE CORNERS. FOR SLAB ON GRADE, PLACE THE BARS AT MID DEPTH OR BELOW THE REINFORCING MAT AND 3 INCHES CLEAR FROM THE CORNER.
17. CONDUITS ARE NOT ALLOWED IN SLABS, BEAMS, WALLS OR COLUMNS. ALL CONDUITS SHALL BE SUSPENDED FROM OR ATTACHED TO THE CONCRETE STRUCTURE.

18. PROVIDE SLEEVES, MECHANICAL OPENINGS, CONDUITS, PIPES, RECESSES, DEPRESSIONS, CUREW AND ALL EMBEDDED ITEMS AS SHOWN ON THE ARCHITECTURAL AND MECHANICAL DRAWINGS OR AS REQUIRED BY EQUIPMENT MANUFACTURERS. MINIMUM CONCRETE BETWEEN SLEEVES SHALL BE 6". SHOP DRAWINGS SHALL CLEARLY INDICATE THE INSTALLATION OF THESE ITEMS. ALL EXPOSED CONCRETE EDGES SHALL BE CHAMFERED TO 3/4"x3/4" MINIMUM UNLESS NOTED OTHERWISE. DO NOT PROVIDE CHAMFERS AT INSIDE FACE OF OVERHEAD DOORS OR AT STOREFRONT OPENINGS.
19. BESIDES FOLLOWING ARTICLE 6.3 OF ACI 318 FOR EMBEDDED ITEMS FOLLOWING REQUIREMENTS SHALL BE MET:
- A) THE MINIMUM CLEAR DISTANCE BETWEEN CONDUITS AND PIPES SHALL BE 6".
- B) NONE PERMITTED IN COLUMNS WITHOUT PRIOR APPROVAL
20. ALL CONSTRUCTION JOINTS IN BEAMS AND WALLS SHALL BE PROVIDED WITH SHEAR KEYS AS SHOWN IN THE DETAILS.
21. SLEEVES PASSING HORIZONTALLY THROUGH GRADE BEAMS:
- A) LOCATE AT MIDDLE THIRD OF BEAM SPAN - MINIMUM 6" AWAY FROM AN INTERIOR MEMBER.
- B) LOCATE AT MIDDLE THIRD OF BEAM DEPTH.
- C) MAXIMUM DIAMETER OF SLEEVE TO BE ONE THIRD OF BEAM DEPTH OR 8" (WHICHEVER IS LESS).
- D) SPACING TO BE AT LEAST THREE SLEEVE DIAMETERS OR 6" (WHICHEVER IS GREATER).
- E) ADD ONE ADDITIONAL SCHEDULED STIRRUP ON EITHER SIDE OF THE SLEEVE. ADD (2) #5 X 5'-0" TOP AND BOTTOM CENTERED AT SLEEVE.
- F) NO SLEEVES LONGITUDINALLY IN BEAMS. PASS SLEEVES ONLY AT RIGHT ANGLES TO BEAMS.
22. ALL MIXING, TRANSPORTING, PLACING AND CURING OF CONCRETE SHALL BE DONE IN ACCORDANCE WITH THE RECOMMENDATIONS OF THE AMERICAN CONCRETE INSTITUTE, ACI 301, LATEST EDITION.
23. ALL CONCRETE SHALL BE CONSOLIDATED WITH A CONCRETE VIBRATOR AS PER THE REQUIREMENTS OF ACI 318 AND ACI 308R, LATEST EDITION.
24. HOT WEATHER CONCRETING SHALL CONFORM TO ACI305 AND COLD WEATHER CONCRETING SHALL CONFORM TO ACI 306.
25. ALL BASE PLATES AND ANCHOR RODS SHALL BE PROTECTED WITH 3" (MIN.) OF CONCRETE. ANCHOR RODS SHALL BE FABRICATED FROM FULL BODIED STEEL RODS CONFORMING TO ASTM F1554 GR 36, WASHERS CONFORMING TO ASTM F844 AND NUTS CONFORMING TO ASTM A194 OR A563 AND HAVING THE SAME DIAMETER AS THE BOLT DIAMETER. BOLTS SHALL BE SET USING RIGID TEMPLATES.
26. HIGH DENSITY STYROFOAM SHALL BE PANELIZED POLYSTYRENE RIGID FORM INSULATION WITH MINIMUM COMPRESSIVE STRENGTH OF 40 PSI (EPS)9 PER ASTM D6817. THICKNESS SHALL BE AS INDICATED IN DETAILS AND DRAWINGS. AVAILABLE MANUFACTURERS INCLUDE: U.C. INDUSTRIES, INC, DOW CHEMICAL COMPANY, AND AMOCO PRODUCTS COMPANY.

POST INSTALLED ANCHORS

ANCHOR MATERIALS

1. MECHANICAL ANCHORS SHALL BE TESTED AND ASSESSED IN ACCORDANCE WITH THE MOST RECENT EDITION OF ACI 355.2 QUALIFICATION OF POST-INSTALLED MECHANICAL ANCHORS IN CONCRETE AND COMMENTARY. ACCEPTABLE MECHANICAL ANCHORS ARE AS FOLLOWS:
- EXPANSION ANCHORS SHALL BE HILTI KWIK BOLT T22
- | ANCHOR DIAMETER | MINIMUM EMBEDMENT |
|-----------------|-------------------|
| 1/2 INCH | 3-1/4" |
| 5/8 INCH | 4" |
| 3/4 INCH | 4-3/4" |
2. ADHESIVE ANCHOR SYSTEMS SHALL BE TESTED AND ASSESSED IN ACCORDANCE WITH THE MOST RECENT EDITION OF ACI 355.4 QUALIFICATION OF POST-INSTALLED ADHESIVE ANCHORS IN CONCRETE (355.4) AND COMMENTARY. ACCEPTABLE ADHESIVE ANCHORS ARE AS FOLLOWS:

CHEMICAL ADHESIVE ANCHORS FOR CONCRETE SHALL BE HILTI HIT-HY 100 SYSTEM

ANCHOR DIAMETER OR BAR SIZE	MINIMUM EMBEDMENT
NO. 3 BAR	4"
1/2 INCH OR NO. 4 BAR	4-1/2"
5/8 INCH OR NO. 5 BAR	6"
3/4 INCH OR NO. 6 BAR	7"
7/8 INCH OR NO. 7 BAR	8"

CHEMICAL ADHESIVE ANCHORS FOR MASONRY SHALL BE HILTI HIT-HY 100 SYSTEM

ANCHOR DIAMETER OR BAR SIZE	MINIMUM EMBEDMENT
NO. 3 BAR	4"
1/2 INCH OR NO. 4 BAR	4-1/2"
5/8 INCH OR NO. 5 BAR	5-3/4"
3/4 INCH OR NO. 6 BAR	6-3/4"

3. AN APPROVED EQUAL TESTED AND ASSESSED IN ACCORDANCE WITH ACI 355.4 AND PROVIDING THE MINIMUM BOND STRESS VALUES BELOW FOR THE SPECIFIED CONDITIONS. BULK-MIXED (E.G., BUCKET-MIXED) ADHESIVES ARE NOT PERMITTED.
4. ADHESIVE ANCHORS SELECTED FROM PARAGRAPH ABOVE SHALL BE SUPPLIED AS AN ENTIRE SYSTEM. THE SYSTEM SHALL INCLUDE, BUT IS NOT LIMITED TO, MANUFACTURERS PRINTED INSTALLATION INSTRUCTIONS (MPII) AS SUPPLIED WITH THE ADHESIVE, ADHESIVE CARTRIDGE, MIXING NOZZLE, EXTENSION TUBE, DISPENSER, AND ALL REQUIRED EQUIPMENT FOR PROPERLY CLEANING THE DRILLED HOLE.
5. ANCHOR DESIGN SHALL BE IN ACCORDANCE WITH CHAPTER 17 OF ACI 318 MOST RECENT EDITION. FOR ADHESIVE ANCHORS, THE FOLLOWING MINIMUM DESIGN VALUES FOR BOND STRESS WERE ASSUMED FOR THE DESIGN USING THE ABOVE ADHESIVE ANCHOR ASSEMBLIES FOR IMPACT-OR ROCK-DRILLED HOLES:
- A) CRACKED CONCRETE BOND STRESS: CR = 2500 PSI
- B) UNCRACKED CONCRETE BOND STRESS: UNCR = 3000 PSI
6. ALL-THREADED ROD (EYEBOLTS, THREADED STUDS, INTERNAL THREADED PARTS) TO BE USED IN ADHESIVE ANCHOR ASSEMBLIES SHALL CONFORM TO ASTM A36, A193 (GRADE B7), A307, B348 (BD), F1554 OR OTHER APPROVED ANCHOR ASSEMBLY TYPES. (STAINLESS STEEL ANCHOR RODS SHALL BE AISI TYPE 304 OR TYPE 316.) THREADS SHALL BE UNC COARSE THREADS, UNLESS NOTED OTHER-WISE.
7. COMPATIBLE NUTS AND WASHERS SHALL BE FURNISHED WITH THE ALL-THREAD ROD AND CONSIDERED PART OF THE ASSEMBLY. THE COST OF THE HARDWARE SHALL BE CONSIDERED INCIDENTAL TO THE INSTALLED ADHESIVE ANCHOR ASSEMBLY.
8. NUTS, WASHERS, AND OTHER HARDWARE USED WITH AN ALL-THREADED BAR ADHESIVE ANCHOR SYSTEM OR WITH A MECHANICAL EXPANSION ANCHOR SHALL HAVE A MATERIAL OR AN ALLOY DESIGNATION THAT IS COMPATIBLE WITH THE ANCHOR ROD/ALLOY. GALVANIZED ASSEMBLIES SHALL BE HOT-DIP GALVANIZED IN ACCORDANCE WITH ASTM A153 CLASS C. ELECTROPLATE GALVANIZING IS NOT ACCEPTABLE. DISSIMILAR METAL ASSEMBLIES SHALL BE SEPARATED BY NYLON, EPDM, OR OTHER APPROVED NON-METALLIC WASHERS.
9. REINFORCING BARS TO BE USED IN ADHESIVE ANCHOR ASSEMBLIES (E.G., AS ANCHOR REINFORCEMENT) OR AS POST-INSTALLED REINFORCING SHALL CONFORM TO ASTM A615, A706, A995, OR A1035.

GENERAL INSTALLATION GUIDELINES

1. CONCRETE SHALL HAVE A MINIMUM COMPRESSIVE STRENGTH (f'c) OF 2,500 PSI AT THE TIME OF ADHESIVE ANCHOR INSTALLATION.
2. CONCRETE AT TIME OF ADHESIVE ANCHOR INSTALLATION SHALL HAVE A MINIMUM AGE OF 21 DAYS. FOR INSTALLATION OF ADHESIVE ANCHORS IN CONCRETE HAVING AN AGE LESS THAN 21 DAYS, TESTS SHALL BE CONDUCTED TO VERIFY THE PERFORMANCE OF THE PRODUCT IN ACCORDANCE WITH ACI 355.4.
3. THE CONCRETE TEMPERATURE AT THE TIME OF ADHESIVE ANCHOR INSTALLATION SHALL BE AT LEAST 50°F UNLESS TESTING HAS BEEN CONDUCTED IN ACCORDANCE WITH RECOGNIZED CRITERIA TO VERIFY PERFORMANCE IN CONCRETE AT LOWER TEMPERATURES.
4. EMBEDMENT DEPTH AND MINIMUM ANCHOR PROJECTION OF THE ANCHOR ELEMENT FROM THE CONCRETE SURFACE SHALL BE AS SHOWN ON THE DRAWING OR DETAIL FOR THE PARTICULAR ANCHOR OR GROUP OF ANCHORS BEING INSTALLED.
5. ADHESIVE CARTRIDGES SHALL BE STORED UNDER CONDITIONS IN COMPLIANCE WITH MANUFACTURER RECOMMENDATIONS REGARDING TEMPERATURE, EXPOSURE TO SUNLIGHT, ETC. AND EVIDENCE OF COMPLIANCE SHALL BE MADE AVAILABLE UPON REQUEST. THE USE OF EXPIRED ADHESIVE, AS INDICATED BY THE EXPIRATION DATE ON THE CARTRIDGE, IS PROHIBITED.

INSTALLATION

1. ADHESIVE ANCHORS SHALL BE INSTALLED BY QUALIFIED PERSONNEL TRAINED TO INSTALL ADHESIVE ANCHORS IN ACCORDANCE WITH THE CONTRACT DOCUMENTS. BOTH POST-INSTALLED EXPANSION AND ADHESIVE ANCHORS SHALL BE INSTALLED IN ACCORDANCE WITH THE MANUFACTURER'S PRINTED INSTALLATION INSTRUCTIONS (MPII). ADHESIVE ANCHORS WITH DIAMETER GREATER THAN 5/8-INCH INSTALLED IN ORIENTATIONS FROM HORIZONTAL TO VERTICAL SHALL EMPLOY A PISTON PLUG FOR THE ADHESIVE INJECTION.
2. INSTALLATION OF ADHESIVE ANCHORS IN ORIENTATIONS FROM HORIZONTAL TO VERTICAL TO SUPPORT SUSTAINED TENSION LOADS SHALL BE PERFORMED BY PERSONNEL CERTIFIED BY THE ACI ADHESIVE ANCHOR INSTALLER CERTIFICATION PROGRAM OR EQUIVALENT. THESE ANCHORS ARE DESIGNATED WITH A (CERT) AFTER THE ANCHOR CALLOUT. NOTE: SOME DOWN-HOLE INSTALLATIONS SHOWN ON DRAWINGS SUPPORT SUSTAINED TENSION LOADS AND ARE SO DESIGNATED WITH A (CERT) AFTER THE ANCHOR CALLOUT.
3. THE INSTALLER'S QUALIFICATIONS SHALL BE SUBMITTED AND APPROVED IN ACCORDANCE WITH THE CONTRACT DOCUMENTS.
4. THE CONTRACTOR SHALL PROVIDE ALL EQUIPMENT REQUIRED TO INSTALL THE EXPANSION AND/OR ADHESIVE ANCHOR INCLUDING, BUT NOT LIMITED TO, DRILLS, SETTING TOOLS, CLEAN OUT BRUSHES, BLOWOUT BULBS, OIL FREE COMPRESSED AIR, VACUUMS, WRENCHES, ETC.
5. UNLESS OTHERWISE SPECIFIED, ANCHORS SHALL BE INSTALLED IN HOLES DRILLED WITH A ROTARY IMPACT HAMMER DRILL OR, WHERE NOT OTHERWISE PRESCRIBED, A ROCK DRILL. WHERE SPECIFIED AND WHERE PERMITTED BY THE MPII, HOLES MAY BE DRILLED WITH A DIAMOND CORE DRILL. IN ALL CASES, THE BIT DIAMETER SHALL BE IN ACCORDANCE WITH THE MPII.
6. ANCHOR HOLES SHALL BE THOROUGHLY CLEANED IN ACCORDANCE WITH THE PROCEDURES SPECIFIED IN THE MPII PRIOR TO ADHESIVE INJECTION.
7. DRILLED AND CLEANED ANCHOR HOLES SHALL BE PROTECTED FROM CONTAMINATION AND WATER (E.G. RAIN) UNTIL THE ADHESIVE IS INSTALLED.
8. A DRILLED ANCHOR HOLE SHALL BE RE-CLEANED JUST PRIOR TO ADHESIVE INJECTION IF, IN THE OPINION OF THE ENGINEER, INSPECTOR, OR ARCHITECT'S REPRESENTATIVE, THE HOLE HAS BECOME CONTAMINATED AFTER INITIAL CLEANING.
9. ADHESIVE SHALL BE INJECTED IN ACCORDANCE WITH THE MPII USING EQUIPMENT AND PROCEDURES AS SPECIFIED THEREIN FOR THE SPECIFIC CONDITIONS ASSOCIATED WITH THE INJECTION. THIS SHOULD BE CLEARLY SPECIFIED IN THE MPII, IF NOT, ANOTHER PRODUCT SHOULD BE SPECIFIED.
10. ANCHOR ELEMENTS TO BE INSTALLED IN THE ADHESIVE SHALL BE CLEAN, OIL FREE, AND FREE OF LOOSE RUST, PAINT, OR OTHER COATINGS. THREADS ON THE PROJECTING PORTION OF THE ANCHOR ELEMENT SHALL BE PROTECTED FROM ADHESIVE CONTAMINATION.
11. INSTALLED ADHESIVE ANCHORS SHALL BE SECURELY FIXED IN-PLACE TO PREVENT DISPLACEMENT WHILE THE ADHESIVE CURES. UNLESS SHOWN OTHERWISE ON THE DRAWINGS, ANCHORS SHALL BE INSTALLED PERPENDICULAR TO THE CONCRETE SURFACE. ANCHORS DISPLACED BEFORE FULL ADHESIVE CURE SHALL BE CONSIDERED DAMAGED AND REPLACED AT THE CONTRACTOR'S EXPENSE.
12. POST-INSTALLED REINFORCING BARS OR ALL-THREADED BARS SHALL NOT BE BENT AFTER BEING INSTALLED UNLESS PERMITTED BY THE SER.



ARCHITECTURE | DESIGN | CONSTRUCTION

15810 PARK TEN PLACE, SUITE 300
HOUSTON, TEXAS 77084
713-465-4650
www.sligroup.com

© COPYRIGHT




National Bank & Trust - Basting

264 FM 969 BLDG. 3
BASTROP, TX 78602

Project Number : 8989

ISSUED FOR CLIENT APPROVAL	DATE
ISSUED FOR BIDDING	
ISSUED FOR PERMIT	09/10/26
ISSUED FOR CONSTRUCTION	


MARK	DESCRIPTION	DATE

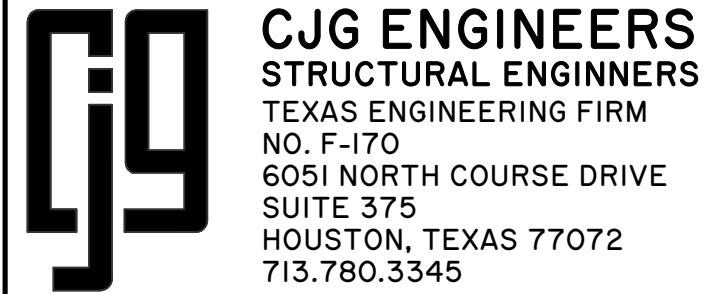

CJG ENGINEERS
STRUCTURAL ENGINEERS
TEXAS ENGINEERING FIRM
NO. F-170
6051 NORTH COURSE DRIVE
SUITE 375
HOUSTON, TEXAS 77072
713.780.3345

The information, ideas, designs, details, layouts, techniques, features, arrangements, plans, sequences, dimensions, allowances, tolerances, conceptions, specifications, intentions, technology or embodiments, as illustrated, arranged, displayed, noted, recorded, indicated, represented, disclosed, evidenced, detailed or otherwise reduced to tangible form hereon, either expressly, inherently or by implication, are the confidential and proprietary information of SLI Design, Inc., and shall not be used for any purpose other than the specific project or undertaking identified on the drawing title block or legend for which they are and have been prepared by SLI Design, Inc. Any other reproduction, disclosure or use of any portion of the confidential and proprietary information of SLI Design, Inc., shall be a breach of the obligation of confidence created by the acceptance of this drawing from SLI Design, Inc. for a specific project or Contract. Any copying, duplicating, reproducing, utilization, alteration, modification, revision or change to this drawing, is expressly prohibited unless done with the prior written consent or approval of SLI Design, Inc., and shall not be undertaken without receipt of such prior written approval. This drawing is loaned by SLI Design, Inc., for the limited purpose of complying with a specific Contract. The drawing remains the property of SLI Design, Inc., and shall be returned upon request or completion of the contract, unless specifically authorized by Contract, under which it was loaned.

PRINT DATE:	9/10/2026 12:12:20 PM
-------------	-----------------------

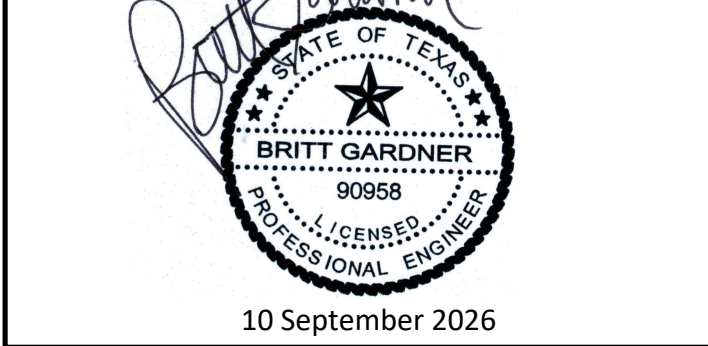

BRITT GARDNER
90958
LICENSED PROFESSIONAL ENGINEER

DRAWING TITLE GENERAL NOTES		
DRAWN BY	JM	SHEET NO.
CHECKED BY	BG	S001
APPROVED BY		