




— 110 —

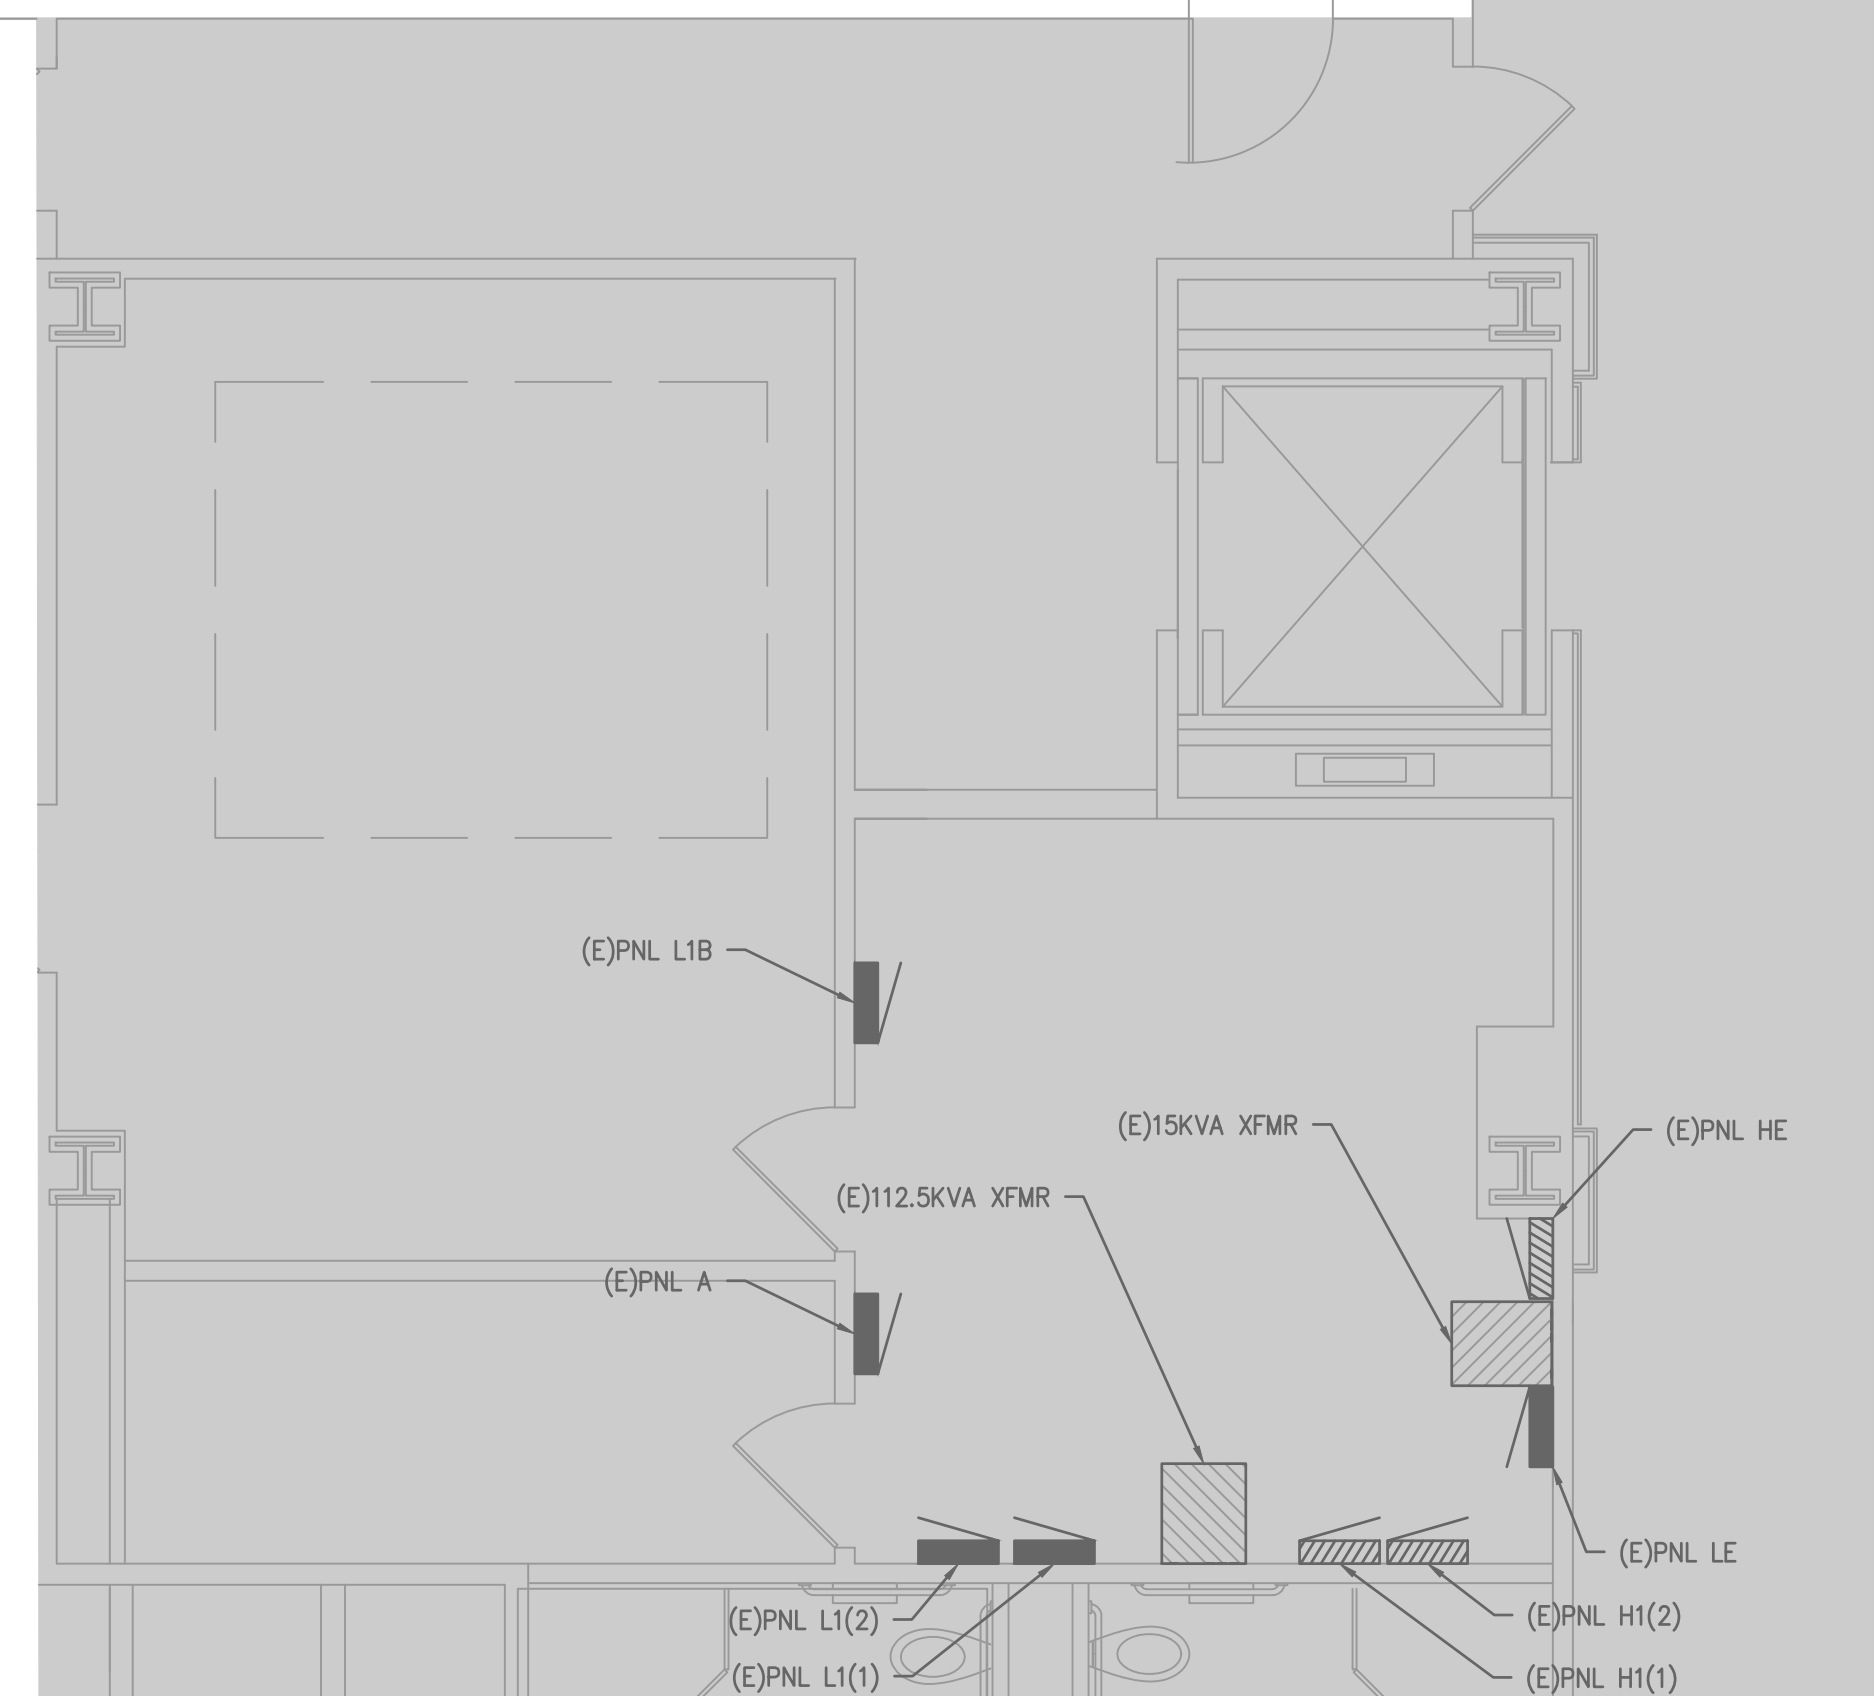

SCALE: 1/4"=1'-0"

4 LIGHTS IN THESE AREAS TO BE CONTROLLED BY EXISTING TIMECLOCK IN ELECTRICAL ROOM. SHOULD THE EXISTING TIMECLOCK NOT HAVE SPACE FOR CIRCUITS REQUIRED, PROVIDE NEW TIMECLOCK TO MATCH EXISTING TYPE

OCCUPANT SENSOR CONTROL SHALL BE PROVIDED IN ALL REQUIRED AREAS. THE CONTROL SHALL AUTOMATICALLY TURN OFF GENERAL LIGHTING IN ALL CONTROL ZONES WITHIN 20 MINUTES AFTER ALL OCCUPANTS HAVE LEFT THE SPACE. REFER TO LIGHTING CONTROL SCHEDULE FOR MORE DETAILS.