


WOODFOREST TOWN CENTER
WOODLANDS, TEXAS

SECRET NUMBER 16,920

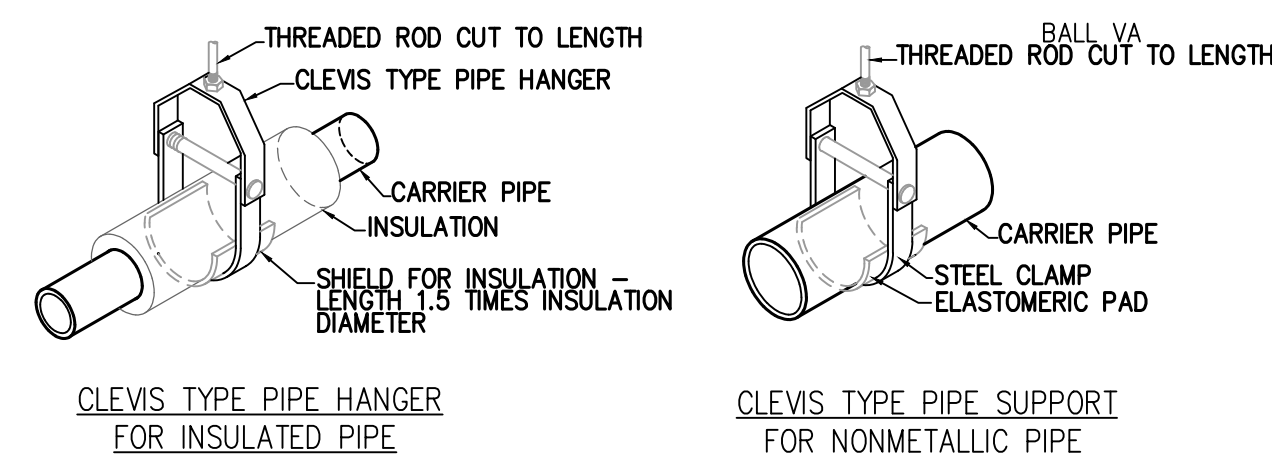


TYPICAL CLEVIS HANGER DETAIL

NOTES:

1. REFER TO MANUFACTURERS SPECIFICATIONS FOR ADDITIONAL INFORMATION.
- 2 16 GA. GALVANIZED SHEET STEEL SADDLE AT LEAST 12" LONG. (INSULATED LINES ONLY)
- 3 INSULATION WHERE SPECIFIED.

CLEVIS PIPE HANGER SUPPORT DETAIL 01

SCALE: NONE

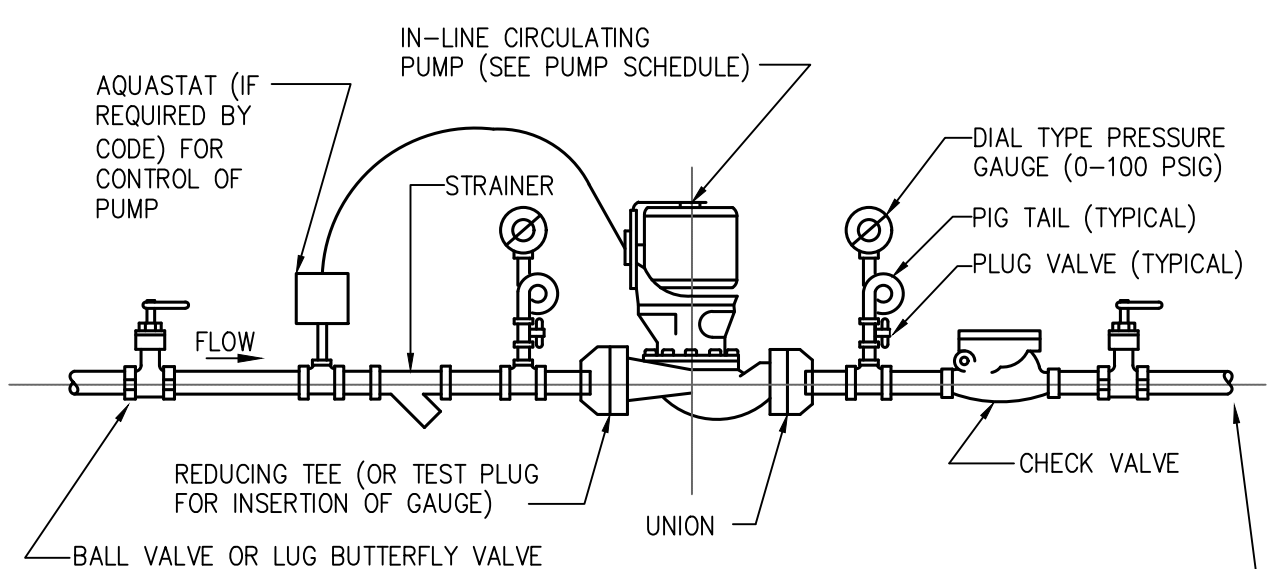


TS-1

TIME SWITCH OPERATION:

1. TIME SWITCH TO OPERATE DURING NORMAL OPERATIONS UNDER A PRESET SCHEDULE.
2. TIME SWITCH TO TURN ON AND OFF PUMP MOTORS ACCORDING TO THE SET SCHEDULE.


IN-LINE CIRCULATING PUMP 03

SCALE: NONE

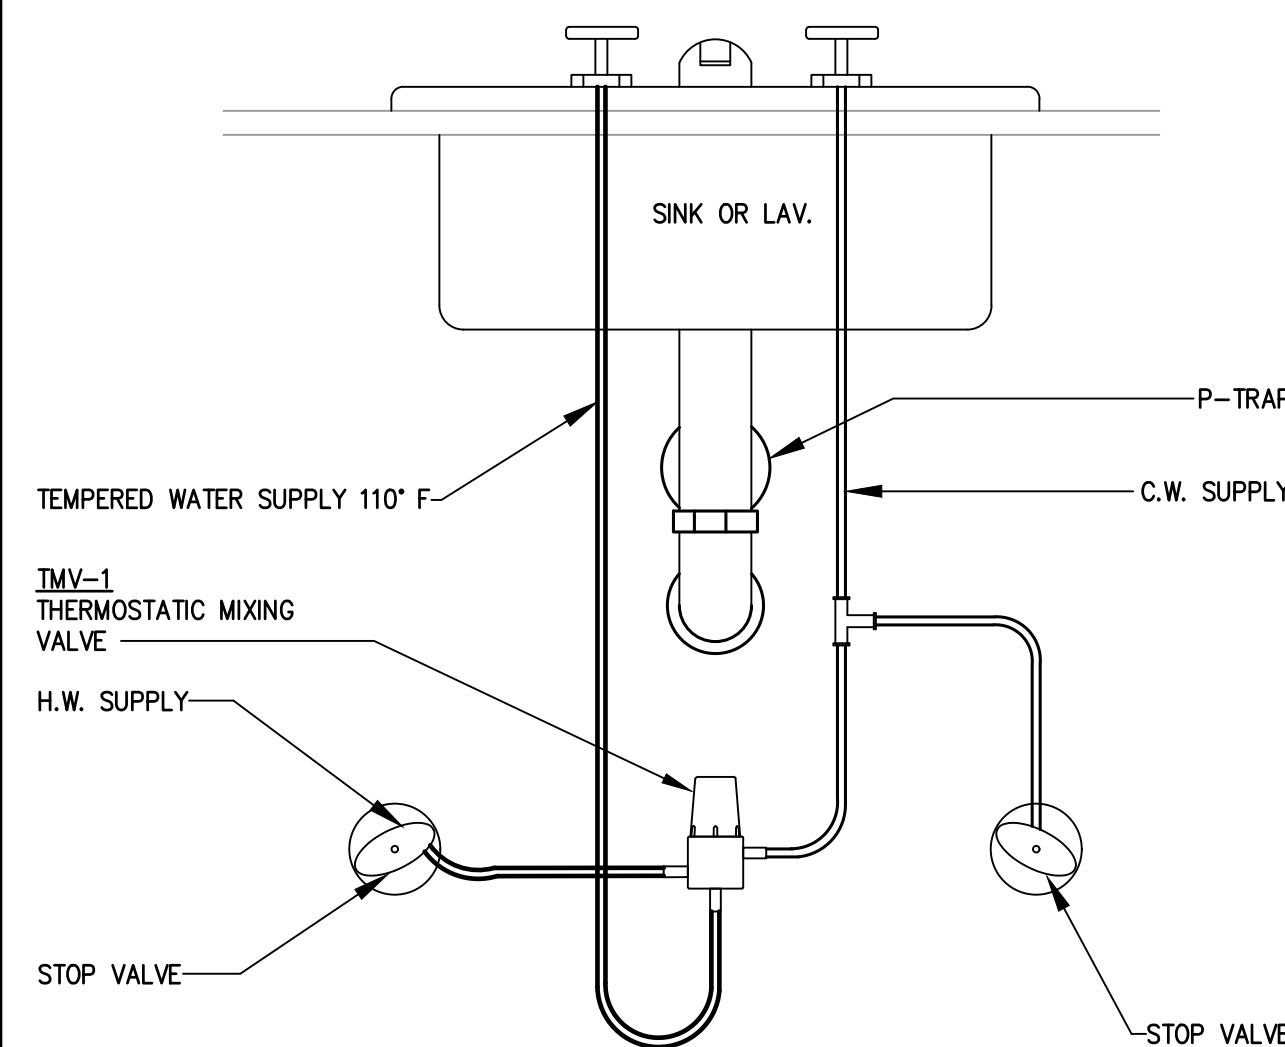

THERMOSTATIC MIXING VALVE TMV-1 02

SCALE: NONE

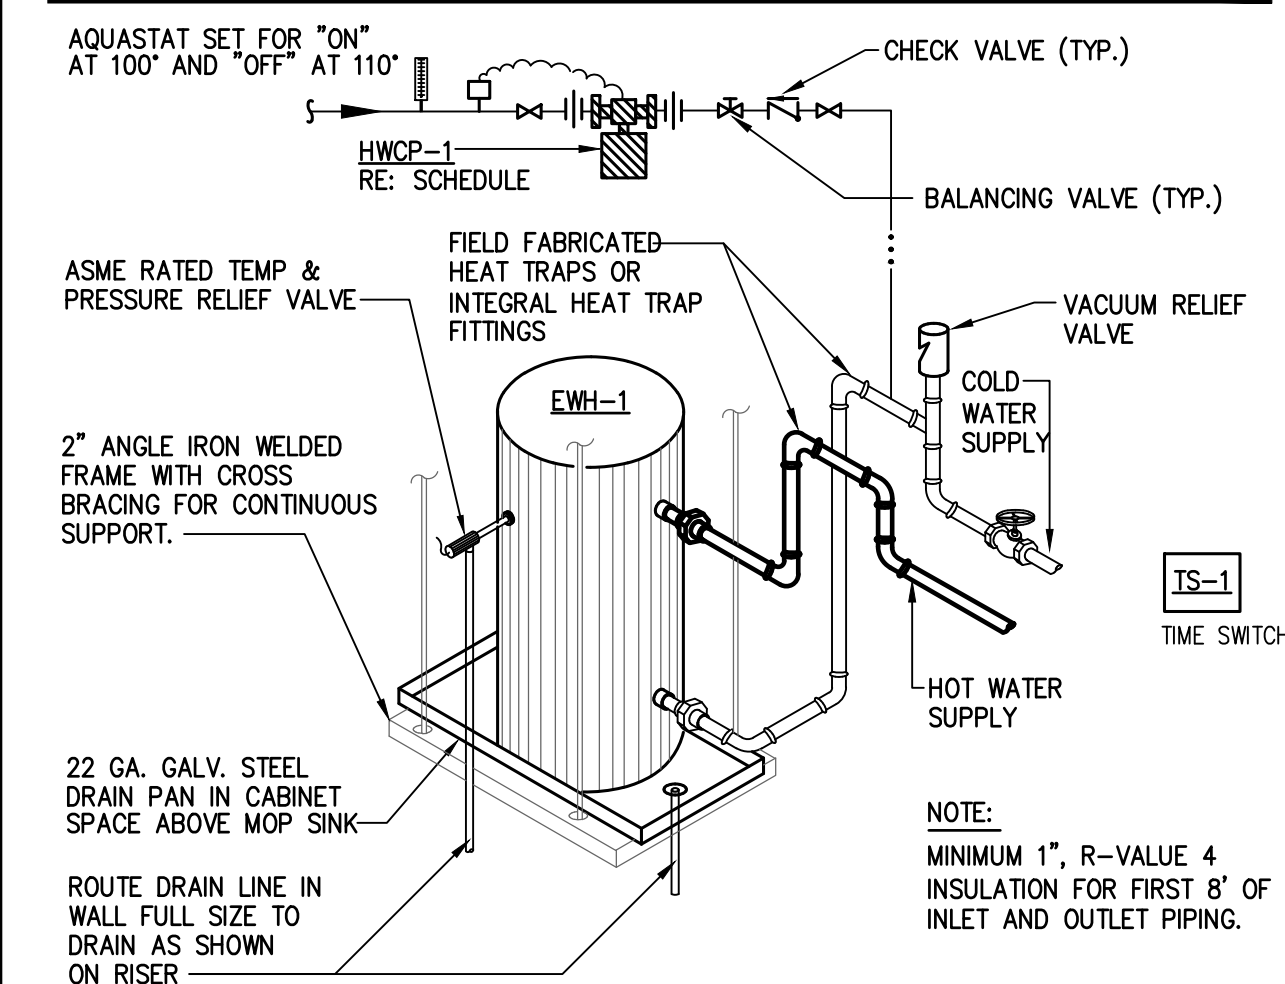

NOTE: CONTRACTOR TO COORDINATE WITH STRUCTURAL ENGINEER
FOR PROPER INSTALLATION OF ANCHORS.

CONTRACTOR TO COORDINATE WITH BUILDING MANAGEMENT TO CONNECT THE FLOOD STOPPER TO THE BAS SYSTEM.

ELECTRICAL WATER HEATER DETAIL 04

SCALE: NONE

PRINT DATE

~~09/30/2025~~

**NOT
FOR
CONSTRUCTION**

DRAWING TITLE
PLUMBING DETAILS

SHEET NO.

P3.01